


NOTES

1. BAGS SHALL BE BURLAP OR WOVEN POLYESTER, FILLED WITH SAND, OVERLAPPED AND TIGHTLY BUTTED TOGETHER.
2. SILT MATERIAL TRAPPED BY SANDBAG SEDIMENT BARRIER SHALL BE REMOVED FROM JOB SITE AS PART OF SAWCUTTING OPERATION.
3. WHEN APPROVED BY THE ENGINEER, SCALE OF SANDBAG SEDIMENT BARRIER MAY BE REDUCED WHERE SAWCUTTING DOES NOT EXCEED 50 LINEAR FEET PER CATCH BASIN.
4. CATCH BASIN SHALL BE CHECKED FOR SILT GENERATED FROM SAWCUTTING OPERATION. EXCESS SILT SHALL BE REMOVED IMMEDIATELY.
5. WHERE SAWCUTTING OPERATION EXCEEDS 300 LINEAR FEET FROM CATCH BASIN, AND WHEN APPROVED BY THE ENGINEER, SANDBAG SEDIMENT BARRIER MAY BE PLACED ADJACENT TO DOWNSTREAM PORTION OF WORKSITE.

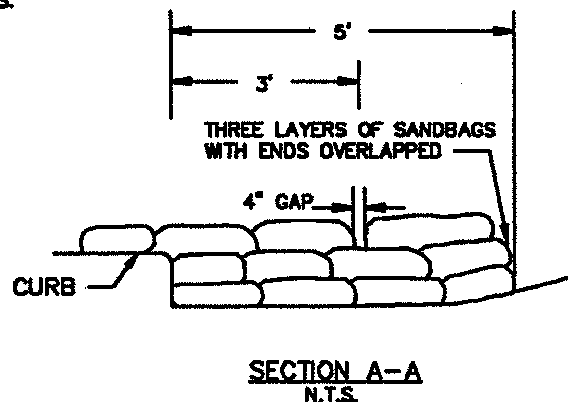

NOTE: THIS PLAN IS NOT A LEGAL ENGINEERING DOCUMENT BUT AN ELECTRONIC DUPLICATE. THE SIGNED CITY OF OAKLAND STANDARD DETAILS FOR PUBLIC WORKS CONSTRUCTION IS AVAILABLE FOR PURCHASE FROM THE CONTRACT ADMINISTRATION DEPARTMENT.

CITY OF OAKLAND

DESIGN AND CONSTRUCTION SERVICES DEPARTMENT



CATCH BASIN SANDBAG SEDIMENT BARRIER

ENGINEERING DESIGN MANAGER

DATE: JANUARY 2002

REV. DATE: _____

DWG.

D-34